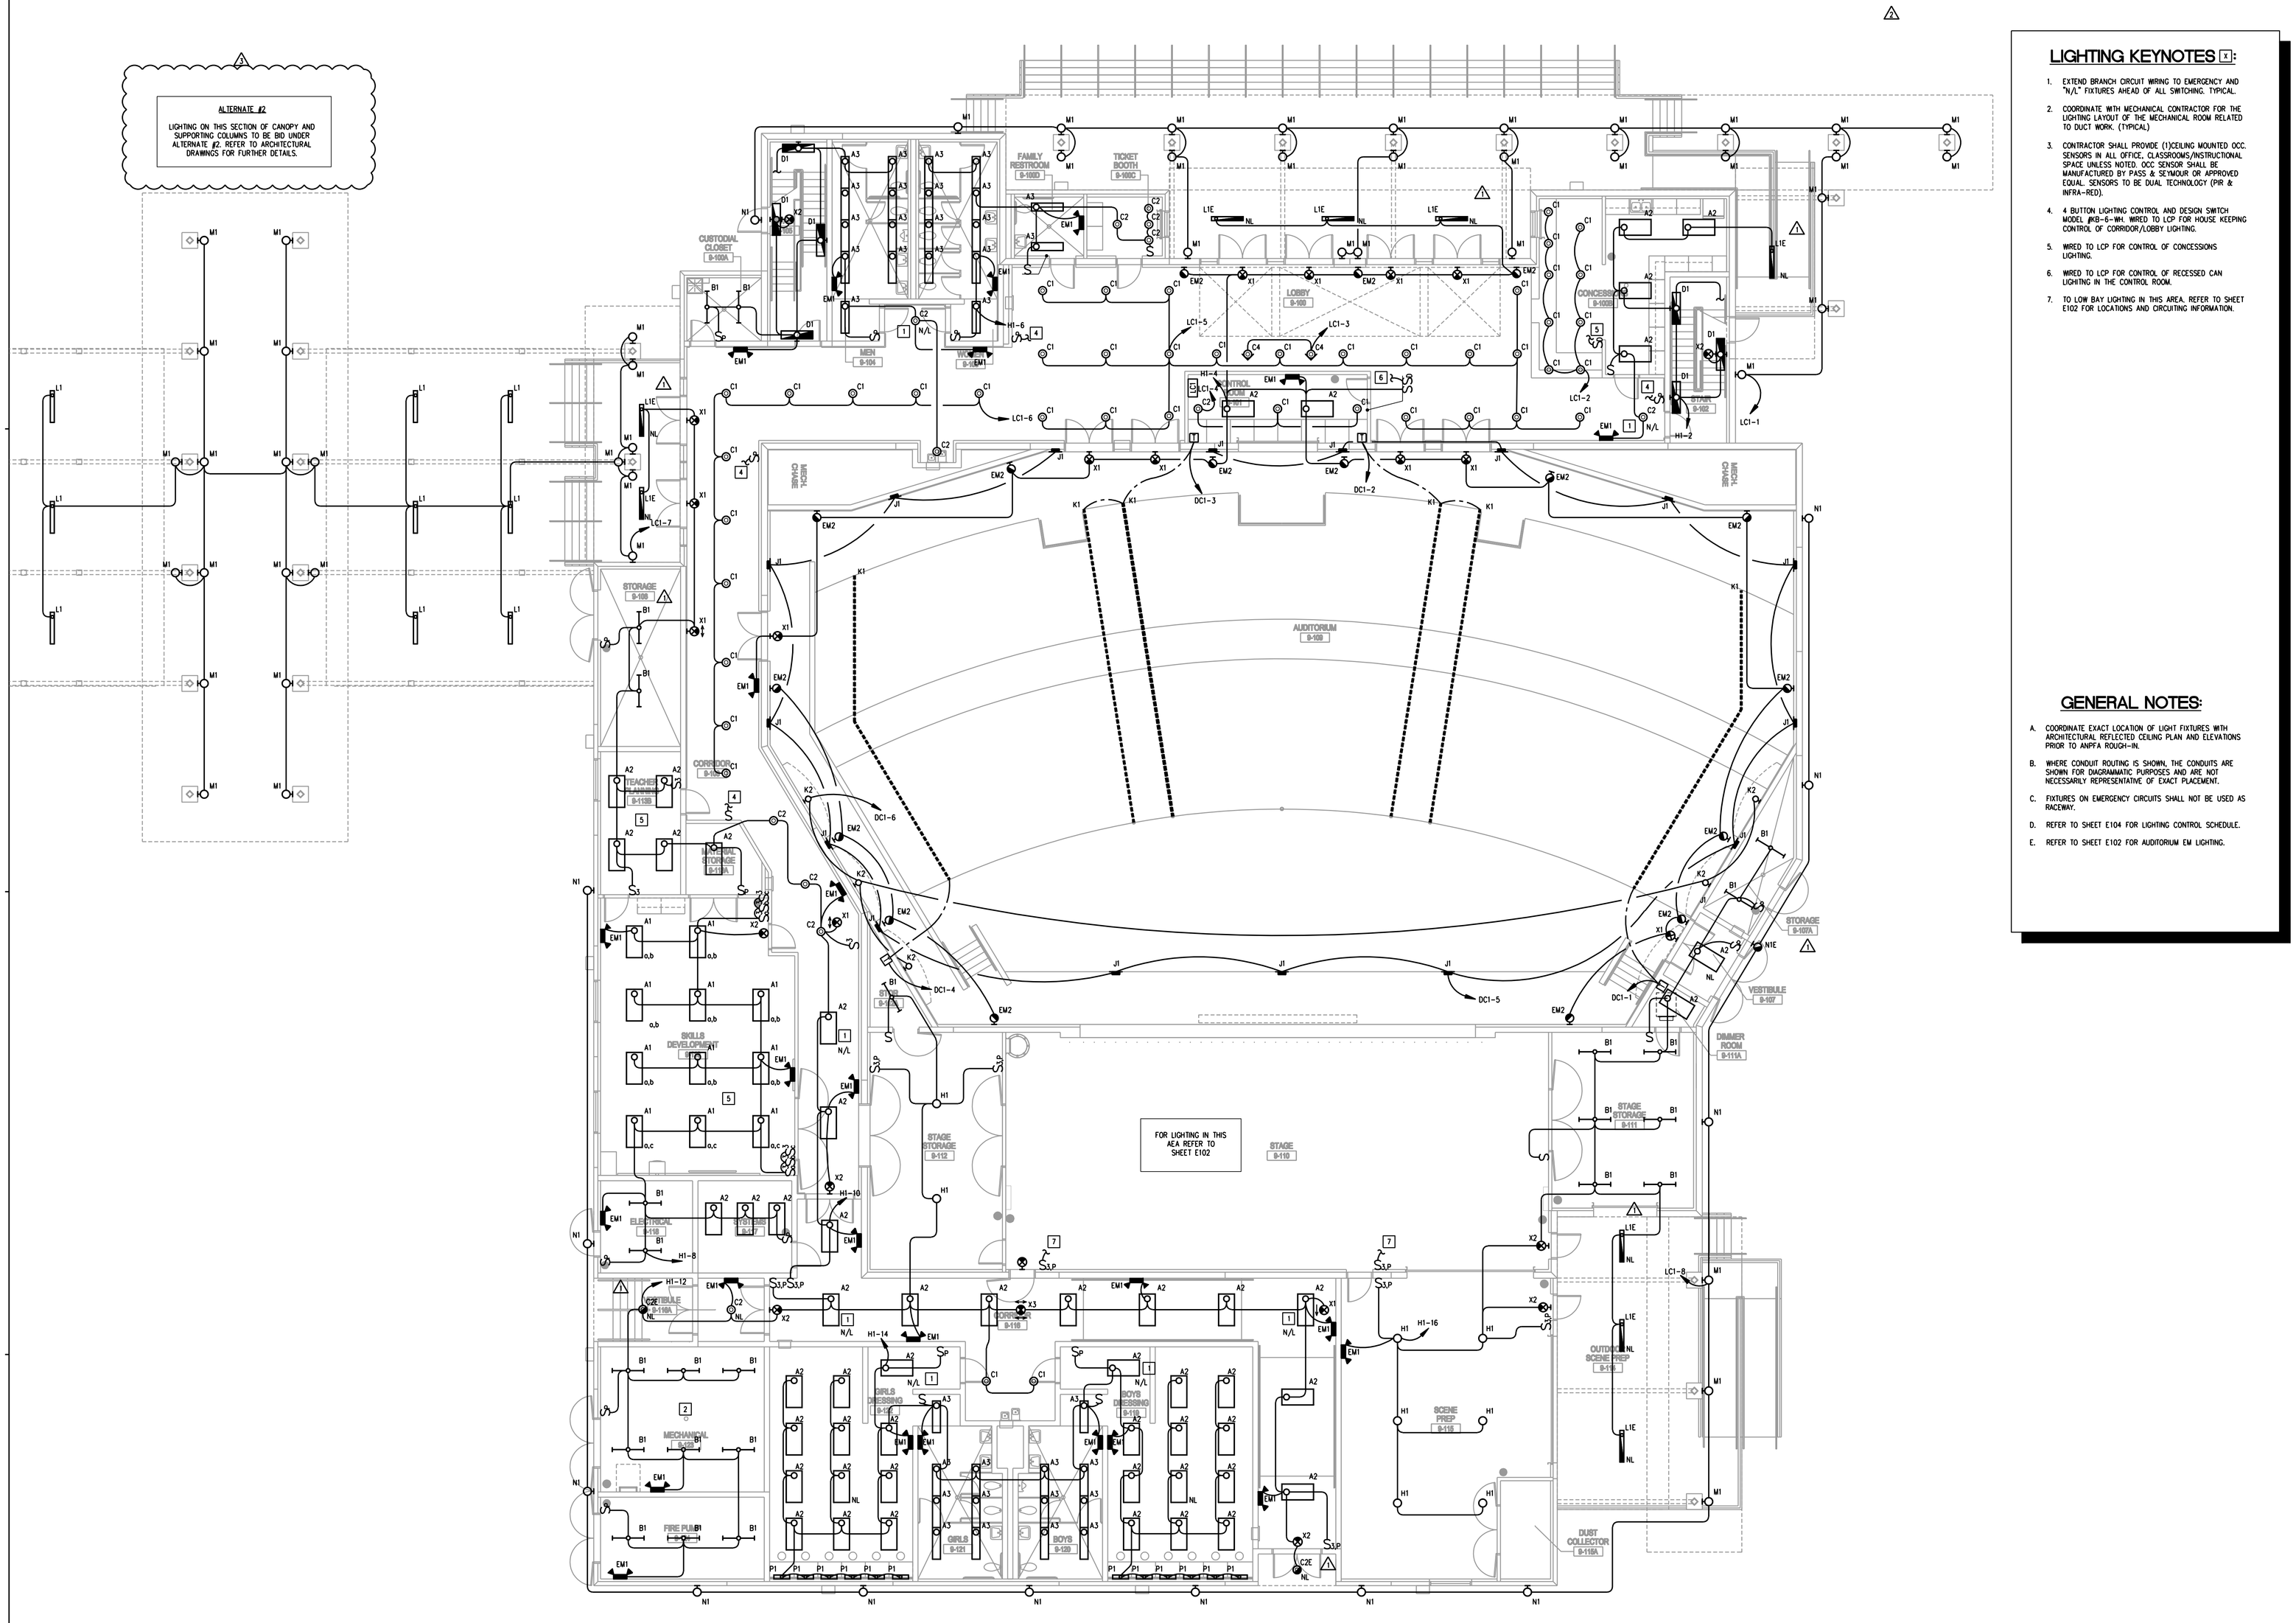

1 FLOOR PLAN - LEVEL 1 - LIGHTING
1/8" = 1'0"

LIGHTING KEYNOTES [X]:

1. EXTEND BRANCH CIRCUIT WIRING TO EMERGENCY AND "N/L" FIXTURES AHEAD OF ALL SWITCHING. TYPICAL.
2. COORDINATE WITH MECHANICAL CONTRACTOR FOR THE LIGHTING LAYOUT OF THE MECHANICAL ROOM RELATED TO DUCT WORK. (TYPICAL)
3. CONTRACTOR SHALL PROVIDE (1)CEILING MOUNTED OCC SENSORS IN ALL OFFICE, CLASSROOMS/INSTRUCTIONAL SPACE UNLESS NOTED. OCC SENSOR SHALL BE MANUFACTURED BY PASS & SEYMOUR OR APPROVED EQUAL. SENSORS TO BE DUAL TECHNOLOGY (PIR & INFRA-RED).
4. 4 BUTTON LIGHTING CONTROL AND DESIGN SWITCH MODEL #WB-6-WH. WIRED TO LCP FOR HOUSE KEEPING CONTROL OF CORRIDOR/LOBBY LIGHTING.
5. WIRED TO LCP FOR CONTROL OF CONCESSIONS LIGHTING.
6. WIRED TO LCP FOR CONTROL OF RECESSED CAN LIGHTING IN THE CONTROL ROOM.
7. TO LOW BAY LIGHTING IN THIS AREA. REFER TO SHEET E102 FOR LOCATIONS AND CIRCUITING INFORMATION.

GENERAL NOTES:

A. COORDINATE EXACT LOCATION OF LIGHT FIXTURES WITH ARCHITECTURAL REFLECTED CEILING PLAN AND ELEVATIONS PRIOR TO ANFPA ROUGH-IN.

B. WHERE CONDUIT ROUTING IS SHOWN, THE CONDUITS ARE SHOWN FOR DIAGRAMMATIC PURPOSES AND ARE NOT NECESSARILY REPRESENTATIVE OF EXACT PLACEMENT.

C. FIXTURES ON EMERGENCY CIRCUITS SHALL NOT BE USED AS RACEWAY.

D. REFER TO SHEET E104 FOR LIGHTING CONTROL SCHEDULE.

E. REFER TO SHEET E102 FOR AUDITORIUM EM LIGHTING.

SCHENKELSHULTZ
ARCHITECTURE
200 east robinson street
suite 300
orlando, fl 32801
voice 407-872-3322
fax 407-872-3303
schenkelshultz.com
SS Lic No - AA-C000937

ALL IDEAS, DESIGNS, ARRANGEMENTS AND PLANS INDICATED OR REPRESENTED BY THIS DRAWING ARE AND SHALL REMAIN THE PROPERTY OF SCHENKELSHULTZ ARCHITECTURE. THEY ARE NOT TO BE USED IN WHOLE OR IN PART FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF SCHENKELSHULTZ ARCHITECTURE. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, TO THE DESIGNS, ARRANGEMENTS AND PLANS INDICATED OR REPRESENTED BY THIS DRAWING ARE RESERVED BY SCHENKELSHULTZ ARCHITECTURE. ALL DRAWINGS, PLANS, SPECIFICATIONS, COMPUTER FILES, FIELD DATA AND DOCUMENTS PREPARED BY SCHENKELSHULTZ ARCHITECTURE ARE INSTRUMENTS OF SERVICE FOR USE SOLELY WITH RESPECT TO THIS PROJECT AND, UNLESS OTHERWISE PROVIDED, SCHENKELSHULTZ ARCHITECTURE SHALL BE DEEMED THE AUTHOR AND OWNER OF SUCH INSTRUMENTS OF SERVICE. THESE INSTRUMENTS OF SERVICE SHALL NOT BE USED BY OR DISCLOSED TO ANY PERSON OR ENTITY FOR ANY PURPOSE WHATSOEVER WITHOUT THE PRIOR WRITTEN CONSENT OF SCHENKELSHULTZ ARCHITECTURE. SUBMISSION OR DISTRIBUTION OF THESE INSTRUMENTS OF SERVICE TO MEET OFFICIAL REGULATORY REQUIREMENTS OR FOR OTHER PURPOSES IN CONNECTION WITH THIS PROJECT IS NOT TO BE CONSTRUED AS PUBLICATION IN DEROGATION OF SCHENKELSHULTZ ARCHITECTURE'S COPYRIGHT OR OTHER RESERVED RIGHTS. ANY REUSE OF THESE INSTRUMENTS OF SERVICE WITHOUT THE PRIOR WRITTEN CONSENT OF SCHENKELSHULTZ ARCHITECTURE WILL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO SCHENKELSHULTZ ARCHITECTURE. THE USER SHALL INDEMNIFY AND HOLD HARMLESS SCHENKELSHULTZ ARCHITECTURE AND ITS CONSULTANTS FROM ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF THE UNAUTHORIZED USE OF THESE INSTRUMENTS OF SERVICE. SUBMISSION OF THESE INSTRUMENTS OF SERVICE TO ANY REGULATORY AGENCY DOES NOT CONSTITUTE AUTHORIZATION OF ANY PREVIOUS UNAUTHORIZED USE. ANY REUSE WITH THE WRITTEN CONSENT OF SCHENKELSHULTZ ARCHITECTURE SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO SCHENKELSHULTZ ARCHITECTURE. THE USER SHALL INDEMNIFY AND HOLD HARMLESS SCHENKELSHULTZ ARCHITECTURE AND ITS CONSULTANTS FROM ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF THE REUSE OF THESE INSTRUMENTS OF SERVICE. ANY REUSE OF THESE INSTRUMENTS OF SERVICE SHALL BE AT THE DISCRETION OF FORMER OWNER/USER.

OCI ASSOCIATES, INC.
CONSULTING ENGINEERING
Orlando • Ft. Pierce • West Palm Beach • Ft. Myers
427 Centerpointe Circle, Suite 1825
Altamonte Springs, FL 32701
(407) 332-5110 Fax: (407) 332-7704
www.ociassociates.com
CERTIFICATE OF AUTHORIZATION #5261

RICHARD R. CREAVALLE
427 CENTERPOINTE CIR., SUITE 1825
ALTAMONTE SPRINGS, FL. 32701
FL. REG. NO.: PE59885

THE SCHOOL DISTRICT OF OSCEOLA COUNTY, FL 1887

Poinciana High School Auditorium

2300 S. Poinciana Blvd.

Kissimmee, Florida 34758

The School District of Osceola County
809 Bill Beck Blvd.

Kissimmee, Florida 34744

revisions:
1 06-05-08 ADDENDUM NO. 1
2 06-05-08 ADDENDUM NO. 2
3 06-19-08 ADDENDUM NO. 3

drawn: JNH
checked: RRC
date: 04/04/08
comm. no.: 0620104

AUDITORIUM FLOOR PLAN - LEVEL 1
LIGHTING

E101

CONFORMED DOCUMENTS

FRI 10 OCT 2008 <11:42:58AM EST> \\08 JOBS\08015 - POINCIANA HS AUDITORIUM\DWGS\E0015E101.DWG